


Physician: **Sex:** F **Collected:** 01/15/2017
Patient: Sample Report **Age:** 24 **Received:** 01/26/2017
Accession #: N/A **Sample Type:** Urine Strip **Completed:** 02/02/2017

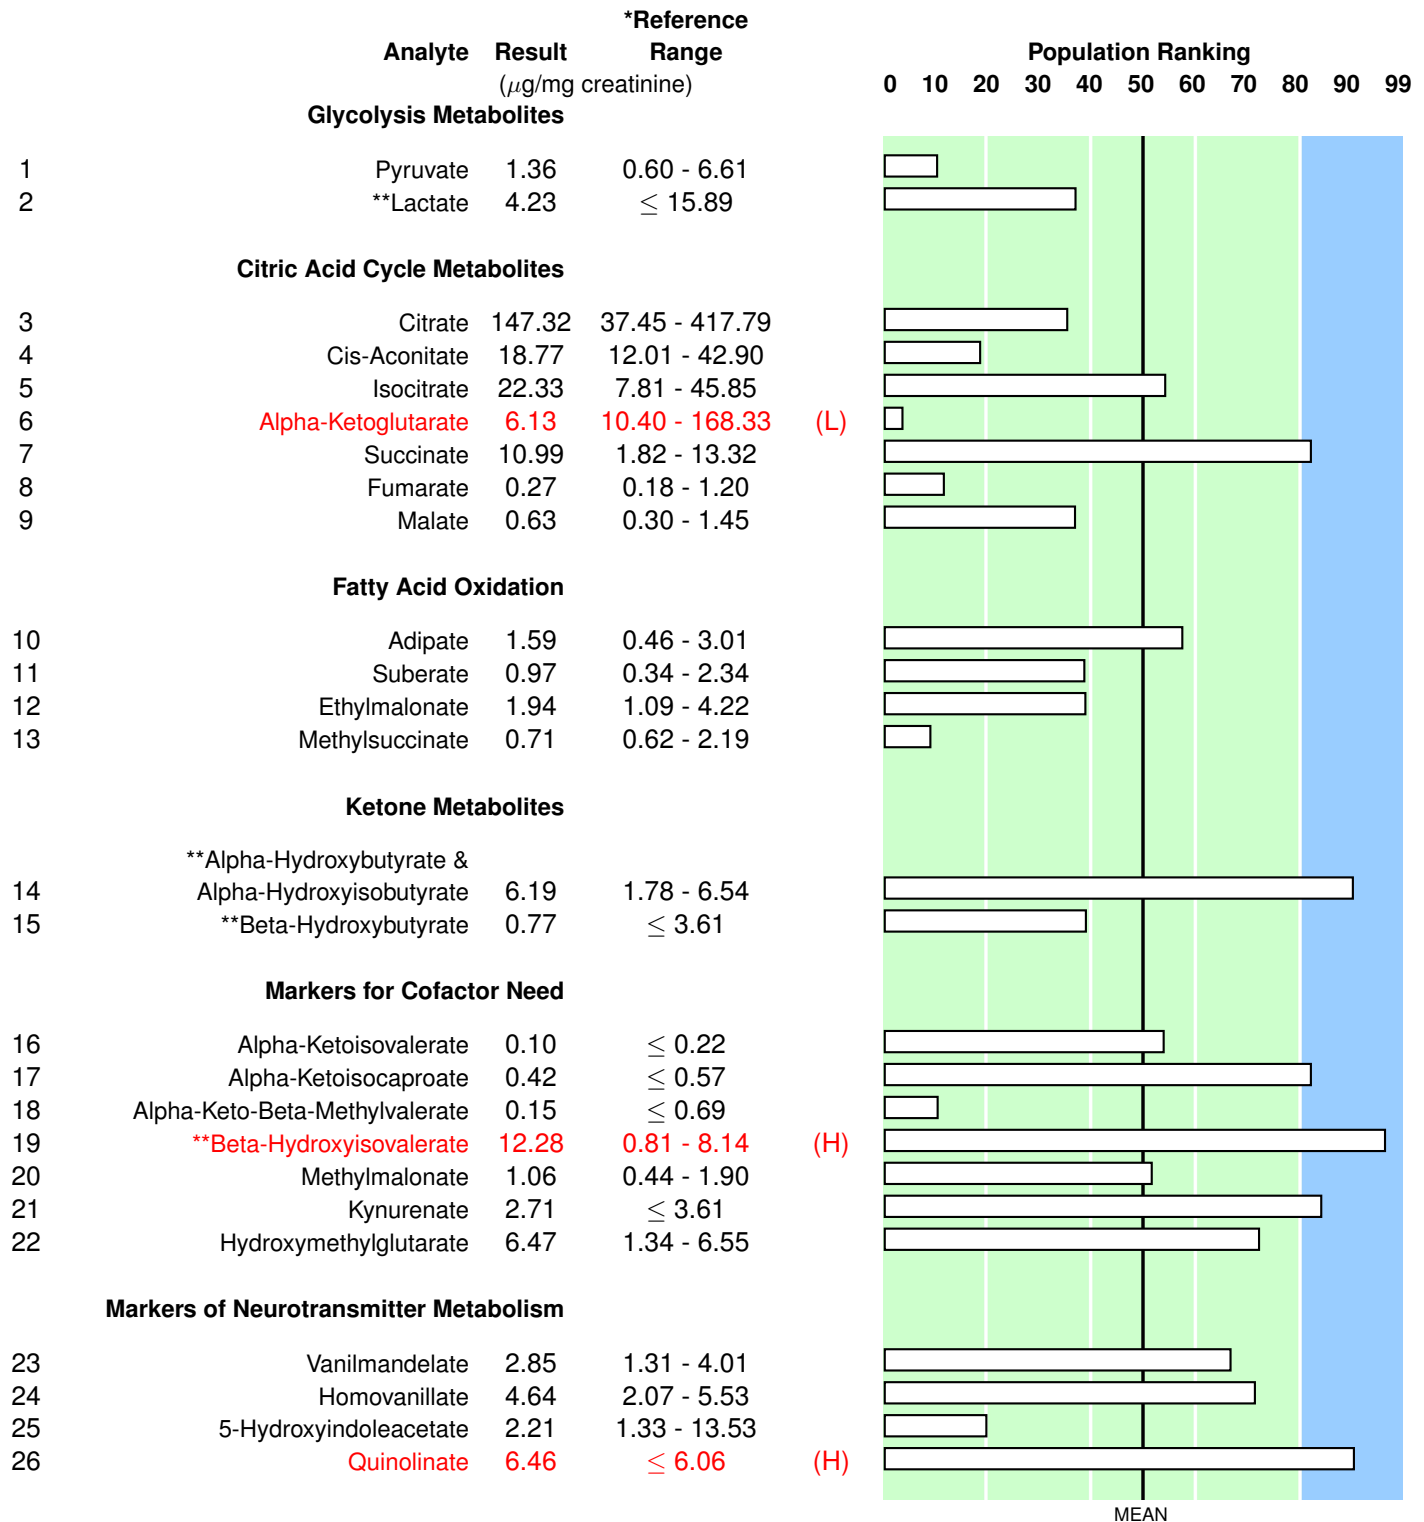

*Reference range updated 1/2/2013. Reference ranges are gender specific and periodically updated; Results are age adjusted for children.


This test is not intended to diagnose, treat, cure, or prevent any disease or replace the medical advice and/or treatment obtained from a qualified healthcare practitioner. US BioTek Laboratories, Inc. has developed and determined the performance characteristic of this test under the Clinical Laboratory Improvement Amendments (CLIA). This test has not been evaluated by the U.S. Food and Drug Administration and is considered for investigational and research purposes only. This test does not assess for neonatal inborn errors of metabolism and is based on stable renal function and normal renal clearance.

The analytes on the panel are subject to change without prior notice.

Lactate is reported as D- and L-Lactate combined. Alpha-Hydroxybutyrate is reported as Alpha-Hydroxybutyrate and Alpha-Hydroxyisobutyrate combined.

**Reference range is not gender or age adjusted.

Physician: **Sex:** F **Collected:** 01/15/2017
Patient: Sample Report **Age:** 24 **Received:** 01/26/2017
Accession #: N/A **Sample Type:** Urine Strip **Completed:** 02/02/2017

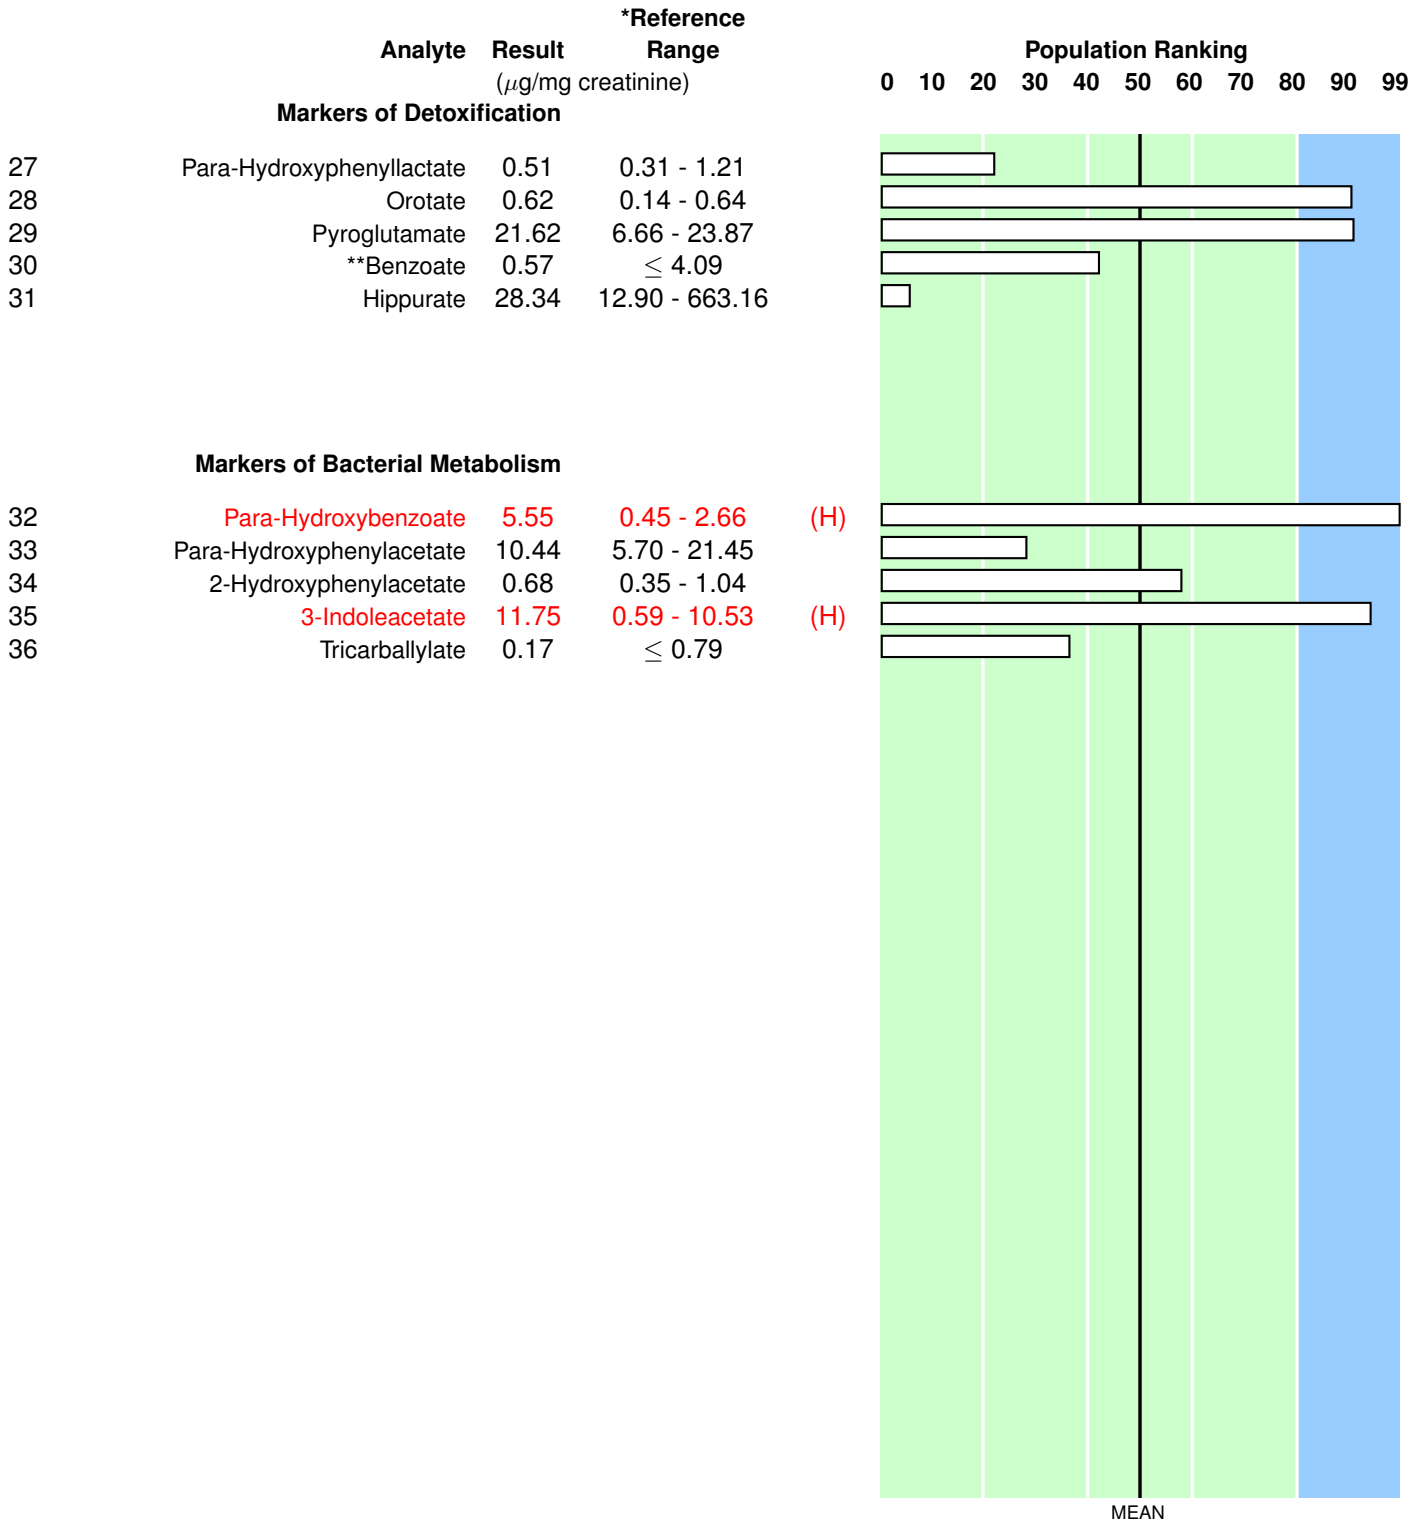

*Reference range updated 1/2/2013. Reference ranges are gender specific and periodically updated; Results are age adjusted for children.

This test is not intended to diagnose, treat, cure, or prevent any disease or replace the medical advice and/or treatment obtained from a qualified healthcare practitioner. US BioTek Laboratories, Inc. has developed and determined the performance characteristic of this test under the Clinical Laboratory Improvement Amendments (CLIA). This test has not been evaluated by the U.S. Food and Drug Administration and is considered for investigational and research purposes only. This test does not assess for neonatal inborn errors of metabolism and is based on stable renal function and normal renal clearance.

The analytes on the panel are subject to change without prior notice. Lactate is reported as D- and L-Lactate combined. Alpha-Hydroxybutyrate is reported as Alpha-Hydroxybutyrate and Alpha-Hydroxyisobutyrate combined.

**Reference range is not gender or age adjusted.

Physician:

Sex: F

Collected: 01/15/2017

Patient: Sample Report


Age: 24

Received: 01/26/2017

Accession #: N/A

Sample Type: Urine Strip

Completed: 02/02/2017

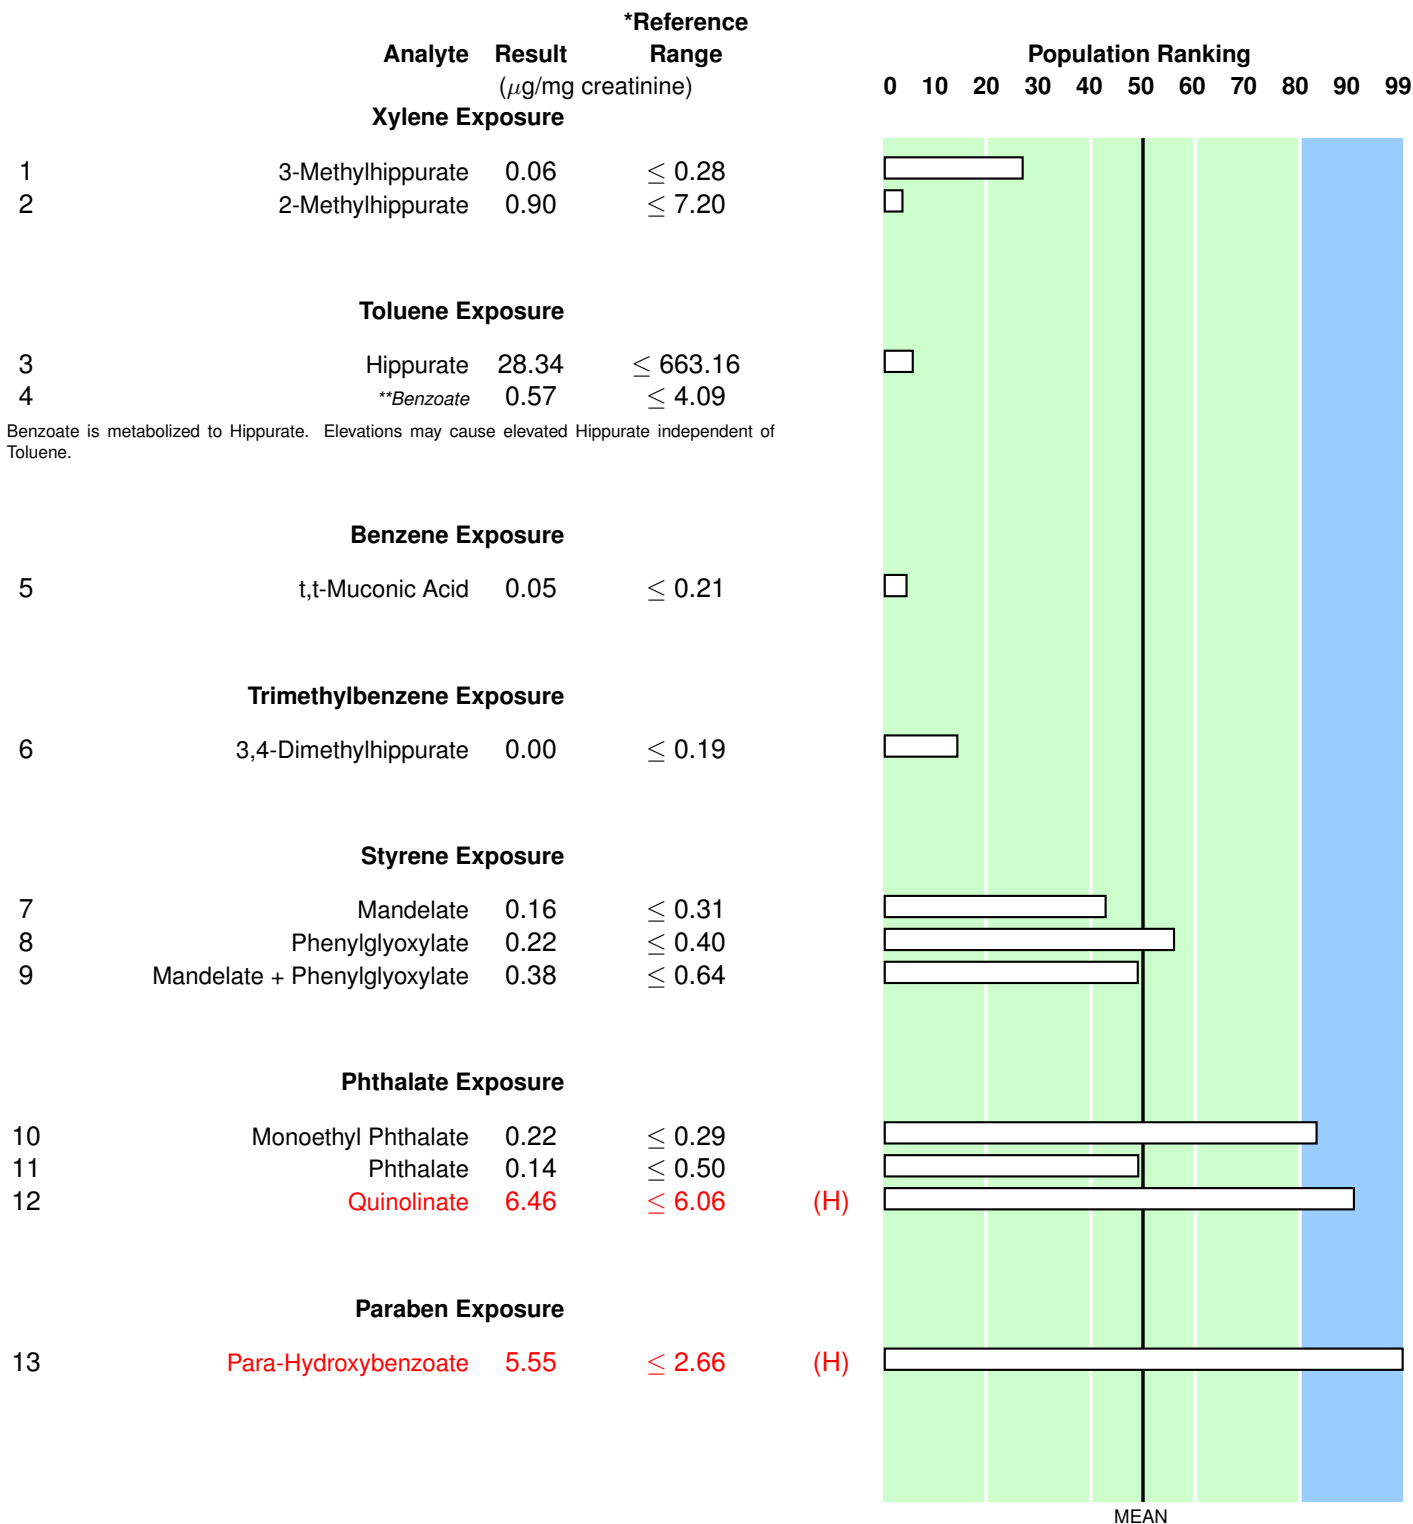

*Reference range updated 1/2/2013. Reference ranges are gender specific and periodically updated; Results are age adjusted for children.

This test is not intended to diagnose, treat, cure, or prevent any disease or replace the medical advice and/or treatment obtained from a qualified healthcare practitioner. US BioTek Laboratories, Inc. has developed and determined the performance characteristic of this test under the Clinical Laboratory Improvement Amendments (CLIA). This test has not been evaluated by the U.S. Food and Drug Administration and is considered for investigational and research purposes only. This test does not assess for neonatal inborn errors of metabolism and is based on stable renal function and normal renal clearance.

The analytes on the panel are subject to change without prior notice.

Lactate is reported as D- and L-Lactate combined. Alpha-Hydroxybutyrate is reported as Alpha-Hydroxybutyrate and Alpha-Hydroxyisobutyrate combined.

**Reference range is not gender or age adjusted.